

IEEE Guide for Determination of Maximum Winding Temperature Rise in Liquid-Filled Transformers

Sponsor

Transformers Committee
of the
IEEE Power Engineering Society

Approved 21 June 2000

IEEE-SA Standards Board

Abstract: Provides guidance for determining the hottest-spot temperature in distribution and power transformers built in accordance with IEEE Std C57.12.00-2000. Describes the important criteria to be evaluated by any thermal model that can accurately predict the hottest-spot temperature in a transformer. Provides guidance for performing temperature-rise tests with direct measurement of the hottest-spot temperatures, and explains the importance of developing an accurate thermal model to properly locate the temperature sensors.

Keywords: distribution transformer, hottest-spot temperature, power transformers, temperature rise test, thermal model

The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

Copyright © 2000 by the Institute of Electrical and Electronics Engineers, Inc.
All rights reserved. Published 2 August 2000. Printed in the United States of America.

Print: ISBN 0-7381-1968-7 SH94826
PDF: ISBN 0-7381-1969-5 SS94826

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

IEEE Standards documents are developed within the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Association (IEEE-SA) Standards Board. Members of the committees serve voluntarily and without compensation. They are not necessarily members of the Institute. The standards developed within IEEE represent a consensus of the broad expertise on the subject within the Institute as well as those activities outside of IEEE that have expressed an interest in participating in the development of the standard.

Use of an IEEE Standard is wholly voluntary. The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least every five years for revision or reaffirmation. When a document is more than five years old and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of all concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE-SA Standards Board
445 Hoes Lane
P.O. Box 1331
Piscataway, NJ 08855-1331
USA

<p>Note: Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken with respect to the existence or validity of any patent rights in connection therewith. The IEEE shall not be responsible for identifying patents for which a license may be required by an IEEE standard or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.</p>

IEEE is the sole entity that may authorize the use of certification marks, trademarks, or other designations to indicate compliance with the materials set forth herein.

Authorization to photocopy portions of any individual standard for internal or personal use is granted by the Institute of Electrical and Electronics Engineers, Inc., provided that the appropriate fee is paid to Copyright Clearance Center. To arrange for payment of licensing fee, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA;

Introduction

(This introduction is not part of IEEE Std 1538-2000, IEEE Guide for Determination of Maximum Winding Temperature Rise in Liquid-Filled Transformers.)

It is required by IEEE Std C57.12.00-1993 that the hottest-spot temperature rise not exceed 80 °C. The hottest-spot temperature rise at rated load is a necessary parameter for determining the loading capability of all transformers. Since there was no approved test or calculation method to demonstrate compliance with the IEEE standard, an IEEE Working Group on Hottest-Spot Temperature Rise Determination in Liquid-Filled Transformers was formed to develop this guide.

This guide provides information to determine the maximum (hottest-spot) temperature rise by calculation and testing. Modern computer technology permits calculation of hottest-spot temperature. Most manufacturers use computers for their design calculations, and it is reasonable to incorporate a thermal subroutine into the programs that would calculate hottest-spot temperature rises. Current personal computers have capabilities that were present only in mainframe computers decades ago. Fiber-optic temperature sensors now permit direct measurement of the temperature of a specific point. By prior analysis of the winding, the sensor can be placed to read the maximum winding temperature. For distribution transformers, thermal testing may be conducted using embedded thermocouples.

This guide applies to liquid-filled power, network, and distribution transformers manufactured in accordance with IEEE Std C57.12.00-1993. Although thermal gradients may be low in properly designed small (10–25 kVA) distribution transformers, the thermal gradients may not be low in the wide range of transformers classified as distribution transformers, which may extend in range to 5000 kVA.

IEEE standards documents are classified as

- a) *Standards*: documents with mandatory requirements.
- b) *Recommended practices*: documents in which procedures and positions preferred by the IEEE are presented.
- c) *Guides*: documents in which alternative approaches to good practice are suggested but no clear-cut recommendations are made.

This document is classified as a guide. Documents with mandatory requirements such as standards use the verb *shall* whereas the other documents use the word *should*. This practice is followed in this guide unless the requirements are mandatory in IEEE Std C57.12.00-1993. Mandatory requirements taken from IEEE Std C57.12.00-1993 are enclosed in quotation marks.

This guide was produced by the IEEE Working Group on Hottest-Spot Temperature Rise Determination for Liquid-Immersed Transformers. At the time the guide was approved, it had the following membership:

D. W. Platts, *Chair*

D. Aho	S. Foss	A. C. McCain
J. Artega	D. L. Galloway	S. E. Michael
R. L. Barker	A. Ghafourian	H. R. Moore
M. F. Barnes	D. F. Goodwin	D. E. Orten
B. L. Beaster	R. L. Grubb	L. W. Pierce
P. Bisbee	A. C. Hall	R. L. Plaster
W. E. Boettger	E. Hanique	H. W. Shertukde
D. J. Cash	K. R. Highton	H. J. Sim
J. M. Christini	J. Hunt	J. W. Smith
D. Chu	V. C. Jhonsa	S. C. Tuli
R. M. Del Vecchio	S. R. Lindgren	F. N. Weffer
D. J. Fallon	M. C. Loveless	R. J. Whearty
P. T. Feghali		C. Wickersham

The following members of the balloting committee voted on this standard:

S.H. Aguirre	William R. Henning	Dhiru S. Patel
Dennis J. Allan	George E. Henry	Wesley F. Patterson
Raymond Allustiarti	Keith R. Highton	Jesse M. Patton
Glenn Andersen	R. Hollingsworth	Mark D. Perkins
Jim Antweiler	Philip J. Hopkinson	Linden W. Pierce
Jacques Aubin	James D. Huddleston, III	Paul Pillitteri
Peter M. Balma	John O. Hunt	R. Leon Plaster
Ron L. Barker	Rowland I. James	Donald W. Platts
Mike Barnes	Virendra Jhonsa	Bertrand Poulin
A. Bartek	Charles W. Johnson	G. Preininger
William H. Bartley	Lars-Erik Juhlin	George J. Reitter
Martin Baur	Joseph J. Kelly	J. C. Riboud
B. L. Beaster	Vladimir Khalin	John R. Rossetti
Edward A. Bertolini	Lawrence A. Kirchner	Vallamkonda Sankar
Enrique Betancourt	Brian Klavonski	Subhas Sarkar
Thomas E. Blackburn, III	Neil J. Kranich	Rick Sawyer
William E. Boettger	Barin Kumar	Pat Scully
Alain Bolliger	Stephen R. Lambert	Dilipkumar Shah
John D. Borst	J. P. Lazar	Hyeong Jin Sim
Donald J. Cash	Singson Lee	James E. Smith
B. Chiu	Mark Loveless	Jerry W. Smith
Peter W. Clarke	Larry A. Lowdermilk	Stephen D. Smith
John N. Davis	Donald L. Lowe	Tarkeshwar Singh
Bob Del Vecchio	Thomas Lundquist	Steven L. Snyder
Dieter Dohnal	Joe D. MacDonald	Ronald J. Stahara
J. C. Duart	Don MacMillan	Craig L. Stiegemeier
Fred E. Elliott	William A. Maguire	Ron W. Stoner
Reto H. Fausch	John W. Matthews	Richard E. Sullivan
Michael A. Franchek	Nigel P. McQuin	John C. Sullivan
J. D. Fyvie	Charles Patrick McShane	Thomas P. Traub
Dudley L. Galloway	Joe Melanson	Al Traut
Harry D. Gianakouros	Sam Michael	Subhash C. Tuli
Donald A. Gillies	C. Kent Miller	Joseph J. Vaschak
Richard D. Graham	Gary N. Miller	Robert A. Veitch
Robert L. Grunert	Harold R. Moore	Loren B. Wagenaar
Michael E. Haas	Daniel H. Mulkey	Barry H. Ward
Ernst Hanique	R. J. Musil	Joe D. Watson
N. Wayne Hansen	Shantanu Nandi	Robert Whearty
Kenneth S. Hanus	E. T. Norton	Christopher Wickersham
James H. Harlow	Paul E. Orehek	A. L. Wilks
Robert H. Hartgrove	Klaus Papp	B. Scott Wilson
R. R. Hayes	B. K. Patel	William G. Wimmer

When the IEEE-SA Standards Board approved this standard on 21 June 2000, it had the following membership:

Donald N. Heirman, *Chair*

James T. Carlo, *Vice Chair*

Judith Gorman, *Secretary*

Satish K. Aggarwal
Mark D. Bowman
Gary R. Engmann
Harold E. Epstein
H. Landis Floyd
Jay Forster*
Howard M. Frazier
Ruben D. Garzon

James H. Gurney
Richard J. Holleman
Lowell G. Johnson
Robert J. Kennelly
Joseph L. Koepfinger*
Peter H. Lips
L. Bruce McClung
Daleep C. Mohla

James W. Moore
Robert F. Munzner
Ronald C. Petersen
Gerald H. Peterson
John B. Posey
Gary S. Robinson
Akio Tojo
Donald W. Zipse

*Member Emeritus

Also included is the following nonvoting IEEE-SA Standards Board liaison:

Alan Cookson, *NIST Representative*
Donald R. Volzka, *TAB Representative*

Noelle D. Humenick
IEEE Standards Project Editor

Contents

1. Overview	1
1.1 Scope	1
1.2 Purpose	1
2. References	2
3. Definitions	2
4. Test methods	4
4.1 Direct measurement by fiber optic detectors	4
4.2 Direct measurement by thermocouples	4
4.3 Prototype test data	5
4.4 Test windings	5
5. Mathematical models to predict temperature distributions and hottest-spot rises	5
5.1 Fundamentals	5
5.2 Radiator or heat exchanger heat transfer	6
5.3 Fluid flow within the winding	6
5.4 Fluid flow between heat exchangers and winding	6
5.5 Loss distribution	6
5.6 Conduction heat transfer	6
5.7 Considerations for core-form power transformers	6
5.8 Considerations for distribution and small power transformers	8
6. Determination of hottest-spot rise from production thermal tests without direct measurement of hottest-spot temperature	10
7. Documentation and acceptance criteria	11
Annex A (informative) Bibliography on experimental testing to predict or confirm transformer thermal performance	12
Annex B (informative) Bibliography on modeling of transformer thermal performance	15
Annex C (informative) Determination of hottest-spot rise from tests without direct measurement	19

IEEE Guide for Determination of Maximum Winding Temperature Rise in Liquid-Filled Transformers

1. Overview

1.1 Scope

This guide provides guidance for developing mathematical models and test programs to determine the steady state maximum (hottest-spot) and average winding temperature rise over ambient for all liquid-immersed distribution, power, network, and regulating transformers manufactured in accordance with IEEE Std C57.12.00-2000.¹

1.2 Purpose

IEEE Std C57.12.00-2000, subclause 5.11.1.1, states, “the maximum (hottest-spot) winding temperature rise above ambient temperature shall be determined by either

- a) Direct measurement during a thermal test in accordance with IEEE Std C57.12.90-1999. A sufficient number of direct reading sensors should be used at expected locations of the maximum temperature rise as indicated by prior testing or loss and heat transfer calculations.
- b) Direct measurement on an exact duplicate transformer design per a).
- c) Calculations of the temperatures throughout each active winding and all leads. The calculation method shall be based on fundamental loss and heat transfer principles and substantiated by tests on production or prototype transformers or windings.”

This guide describes recommendations for a manufacturer’s test program or mathematical model to demonstrate compliance with the above requirements.

¹Information on references can be found in Clause 2.

2. References

This guide should be used in conjunction with the following publications. When the following publications are superseded by an approved revision, the revision should apply.

IEEE Std C57.12.00-2000, IEEE Standard General Requirements for Liquid-Immersed Distribution, Power, and Regulating Transformers.²

IEEE Std C57.12.80-1978 (Reaff 1992), IEEE Standard Terminology for Power and Distribution Transformers.

IEEE Std C57.12.90-1999, IEEE Standard Test Code for Liquid-Immersed Distribution, Power, and Regulating Transformers and IEEE Guide for Short-Circuit Testing of Distribution and Power Transformers.

3. Definitions

3.1 average winding temperature rise: The arithmetic difference between the average winding temperature and the ambient temperature as determined from the change in the ohmic resistance measured across the terminals of the winding in accordance with the test procedures specified in IEEE Std C57.12.90-1999.

3.2 bottom-oil temperature: The temperature of the liquid as measured at an elevation below the bottom of the coils or in the oil flowing from the liquid cooling equipment.

3.3 bottom-oil temperature rise: The arithmetic difference between the bottom-oil temperature and the ambient air temperature.

3.4 core form transformer: A transformer in which those parts of the magnetic circuit surrounded by the windings have the form of legs with two common yokes.

3.5 directed flow: Indicates that the principal part of the pumped oil from heat exchangers or radiators is forced to flow through the windings.

3.6 distribution transformer: A transformer for transferring electrical energy from a primary distribution circuit to a secondary distribution circuit or consumer's service circuit.

3.7 flow direction: A pattern of flow in disc or helical windings caused by alternately blocking the vertical ducts inside and outside the winding to cause the liquid to flow in a zigzag pattern. This construction is used with either directed or non-directed flow transformers.

3.8 H-factor: A dimensionless number for predicting the maximum winding temperature rise over fluid due to increased eddy losses and other factors at the winding hottest-spot location.

3.9 hot-spot: A nonrecommended abbreviated term frequently used as a synonym for the maximum or hottest-spot temperature rise of a winding.

3.10 maximum (hottest-spot) winding temperature: The maximum or hottest temperature of the current carrying components of a transformer winding and leads in contact with insulation or insulating fluid. The hottest-spot temperature is a naturally occurring phenomena due to the generation of losses and the heat-transfer phenomena. It is the highest temperature inside the transformer winding and leads and is

²IEEE publications are available from the Institute of Electrical and Electronics Engineers, 445 Hoes Lane, P.O. Box 1331, Piscataway, NJ 08855-1331, USA (<http://standards.ieee.org/>).

greater than the measured average winding temperature. All transformers have a maximum (hottest-spot) winding temperature.

NOTE—In this guide the hottest-spot rise is not considered to be due to localized manufacturing defects. Defects that affect long term performance or cause the hottest-spot rise to exceed the limits set in IEEE Std C57.12.00-2000 should be corrected.

3.11 maximum (hottest-spot) winding temperature rise: The arithmetic difference between maximum (hottest-spot) winding temperature and the ambient temperature.

3.12 network transformer: A transformer designed for use in a vault to feed a variable capacity system of interconnected secondaries. A network transformer may be of the submersible or of the vault type.

3.13 nondirected flow: Indicates that the pumped fluid from the heat exchangers or radiators flows freely inside the tank, and is not forced to flow through the windings.

3.14 oil: A shortened term for mineral oil that is a specially refined mineral-oil for use as an insulating liquid and coolant in transformers. For the purposes of this document, when terms such as “top oil rise” are used, “oil” should be considered synonymous with “fluid” since fluids other than mineral oil are used. See IEEE Std C57.12.00-2000.

3.15 power transformer: A transformer that transfers electric energy in any part of the circuit between the generator and the distribution primary circuits.

3.16 prototype transformer: A transformer manufactured primarily to obtain engineering data or evaluate manufacturing or design feasibility. Prototypes may be preproduction units or units typical of current designs manufactured for test purposes to obtain data to comply with changes in industry standards or for other reasons.

3.17 radiator: A fluid to air heat exchanging device attached to a transformer for the purpose of exchanging heat from the transformer fluid to the ambient air.

3.18 shell-form transformer: A transformer in which the laminations constituting the iron core surround the windings and usually enclose the greater part of them.

3.19 temperature rise: The difference between the temperature of the part under consideration (commonly the “average winding rise” or the “maximum (hottest-spot) winding temperature rise”) and the ambient temperature.

3.20 top-oil rise: *See: top-oil temperature rise.*

3.21 top-oil temperature: The temperature of the top layer of the insulating fluid in a transformer, representative of the temperature of the top fluid in the cooling flow stream, generally measured 50 mm below the surface of the fluid.

3.22 top-oil temperature rise: The arithmetic difference between the top fluid temperature and the ambient temperature. *Syn: top-oil rise*

4. Test methods

4.1 Direct measurement by fiber optic detectors

Fiber optic temperature detectors may be used to measure temperatures in power transformers. The probes may be removed or remain in the transformer winding for measurement of temperatures under operating conditions. Experience and data using fiber optic probes is given in the references of Annex A. Proper choice of the installation locations is crucial to accurately determining the hottest-spot temperature. The probable location of the hottest-spot should be determined by analysis of the eddy loss distribution, the oil flow distribution, and the heat transfer characteristics of the winding. Redundant sensors should be used at the expected hottest-spot location. A CIGRE survey [B16] reported that two to eight sensors would be adequate if placed in the winding where the higher temperature is expected, but for prototype transformers it was estimated that 20 to 30 sensors would be required. Some researchers have attempted to measure the temperature of the fluid in the winding ducts using fiber optic sensors. It is difficult to obtain a true measurement of the winding duct fluid temperature, and it is recommended that all probes be placed within the winding when a limited number of probes are available. The number of probes and strategic locations should be agreed upon between the purchaser and seller before the transformer is manufactured.

Thermal tests may be conducted at rated load in accordance with IEEE Std C57.12.90-1999. The thermal data may be used to verify the hottest-spot temperature performance for a specific design and to verify thermal models to be used for other designs. Data from tests at loads above and below rating will further assist in the development of thermal models to predict performance of other designs.

4.2 Direct measurement by thermocouples

For distribution transformers, it is feasible to install thermocouples in windings of prototype or actual transformer designs. If the thermal tests are conducted using the “short-circuit method,” the test voltage is usually less than 1000 V. Thermocouples can also be used on some distribution transformer designs when using the “loading back method,” which applies rated voltage. The thermocouple measuring junction is insulated with a thin piece of insulation and inserted between winding turns or layers. Thermocouples should be of a small size to minimize conduction errors and the build of the windings. Thermocouple diameters of 1 mm–2.5 mm are recommended. Due to the low cost of the thermocouples, it is practical to install a large quantity in the winding during the coil winding process. For three-phase transformers or two-legged single-phase units, temperature variations between winding phases or coils are considered minimal. Thus, all the thermocouples may be installed in one winding or coil assembly consisting of primary and secondary windings. The major consideration is that the thermocouples may alter the build of the winding. To assist in development of a mathematical model, thermocouples should be installed to determine temperature variations in circumferential and vertical directions as well as layer to layer.

Tests should include loads above and below rating to obtain useful data for refining the mathematical model and to predict the thermal performance of other designs.

For studies of core loss effects, it is necessary to perform thermal tests by the loading back method with full voltage on the unit. For this reason, it is usually feasible to install thermocouples in only the lower voltage winding, which is usually next to the core.

Due to the voltage hazard, the thermocouples must not remain if the transformer is placed in service. For small transformers, the test transformers are scrapped. For larger units, the windings with the thermocouples may be replaced, and after normal production tests in accordance with IEEE Std C57.12.90-1999, the transformer may be placed in service.

4.3 Prototype test data

During thermal tests on a prototype transformer, the hottest-spot rise may exceed the required value at the rated kVA set for the prototype. The thermal program should be refined based on the prototype data, and production transformer designs are then based on the refined program. Usually, additional thermal testing using thermocouples or fiber optic sensors in another prototype is not needed.

4.4 Test windings

Test windings may be used to obtain data on large power transformers or distribution transformers. See Pierce [B10] for an example. The windings are wound in a noninductive manner so that normal transformer operating voltage is not present. Laboratory or shop power supplies may be used in combination with a transformer to obtain the necessary current. In addition, the winding wire size, material, and number of turns are designed to give the required heat to conduct the thermal tests. The considerations for number of thermocouples, location, and size discussed in 4.2 are also applicable for tests conducted on test windings.

Thermal testing conducted under laboratory conditions using test windings gives useful data on the heat transfer characteristics. However, with the noninductive winding, the only eddy losses present are skin effect losses which are extremely small at 60 Hz. Thus, thermal tests using test windings do not simulate the additional losses due to high eddy losses in the ends of the windings of large power transformers. These additional eddy losses should be considered in the final mathematical model.

5. Mathematical models to predict temperature distributions and hottest-spot rises

5.1 Fundamentals

This clause describes recommendations for a manufacturer's thermal model to demonstrate compliance with the hottest-spot temperature rise limits. The manufacturer should utilize a proven thermal model to locate and calculate the hottest-spot temperature rise in each active winding, and all leads, under rated conditions. The calculation of the hottest-spot temperature rise, using a model that meets the recommendations of this guide should be based on the detailed design knowledge available to the manufacturer. In each case, it is imperative that the manufacturer have data readily available to demonstrate that the calculated values are supported by experimental testing. As required by IEEE Std C57.12.00-2000, "the model shall be based on fundamental loss and heat transfer principles..." The mathematical model should consider the dimensions of all components affecting the losses and heat transfer. General allowances for each element of the hot spot model are not adequate.

The mathematical model should consider

- a) Heat transfer in and from the radiators or heat exchangers and its effect on fluid temperature rise.
- b) The fluid flow within the winding ducts.
- c) Fluid flow interactions with radiators and winding.
- d) The distribution of losses within the winding.
- e) Conduction heat transfer effects within the winding caused by different insulation sizes and the length of the electrical conductors forming the winding.

5.2 Radiator or heat exchanger heat transfer

The heat transfer and fluid flow within the radiators, heat exchanger, and tank should be considered to determine the average fluid rise over ambient. Radiation and convection heat transfer should also be considered. The number of radiators, heat exchangers, fans, and pumps should be considered. The effect of quantity of radiators, fans, and heat exchanger may be determined by thermal tests on transformers with different arrangements and the data correlated. The overall performance, which determines the average fluid temperature rise, is the important factor. Calculation of flow rates within each individual heat exchanger is not required since the temperature distribution within the heat exchanger is not critical for determining the winding temperatures. These factors may be of consideration to a manufacturer wishing to improve the thermal performance of the heat exchanger.

Consideration of the overall friction and pressure drop effects is important for determining the overall flow rate and thus the top and bottom fluid temperature rise.

5.3 Fluid flow within the winding

Conductors surrounded by fluid at the top fluid temperature will have elevated temperatures. An accurate method of calculating the temperature of the fluid throughout the winding is essential to determining the hottest-spot temperature. The heat transfer, flow rates, and resulting fluid temperature should be modeled for each cooling duct. These calculations should account for fluid flow through parallel paths, or through separate ducts, which join for the local heat transfer rate and the adjacent conductor temperature. The program should consider the quantity, location, and size of the cooling ducts and fluid properties.

5.4 Fluid flow between heat exchangers and winding

At steady state, the overall fluid flow through the winding ducts and the outside of the winding equals the fluid flow through the radiators and down the inside tank wall. This flow determines the top and bottom fluid rise and should be considered in the thermal model.

5.5 Loss distribution

The analysis should account for the nonuniform distribution of losses within the winding due to eddy loss and temperature variations. One of the principal causes of extra local loss in the winding conductors is radial flux eddy loss at the winding ends, where the electromagnetic field intercepts the wide dimension of the conductors. The total losses in the subject conductors should be determined using the eddy and circulating current losses in addition to the dc resistance loss. Leakage field analysis may be used to determine the magnitude of the flux and the resulting losses. Connections that are subject to leakage flux heating, such as coil-to-coil connections and some tap-to-winding brazes, should also be considered.

5.6 Conduction heat transfer

The analysis should account for the conduction heat transfer effect of conductor size, length, and the various insulation thickness used throughout the winding.

5.7 Considerations for core-form power transformers

Core-form power transformers utilize round windings of the layer or disc type as illustrated in Figure 1. In addition to the factors listed in 5.1–5.6, factors specific to these winding types are described in the following subclauses.

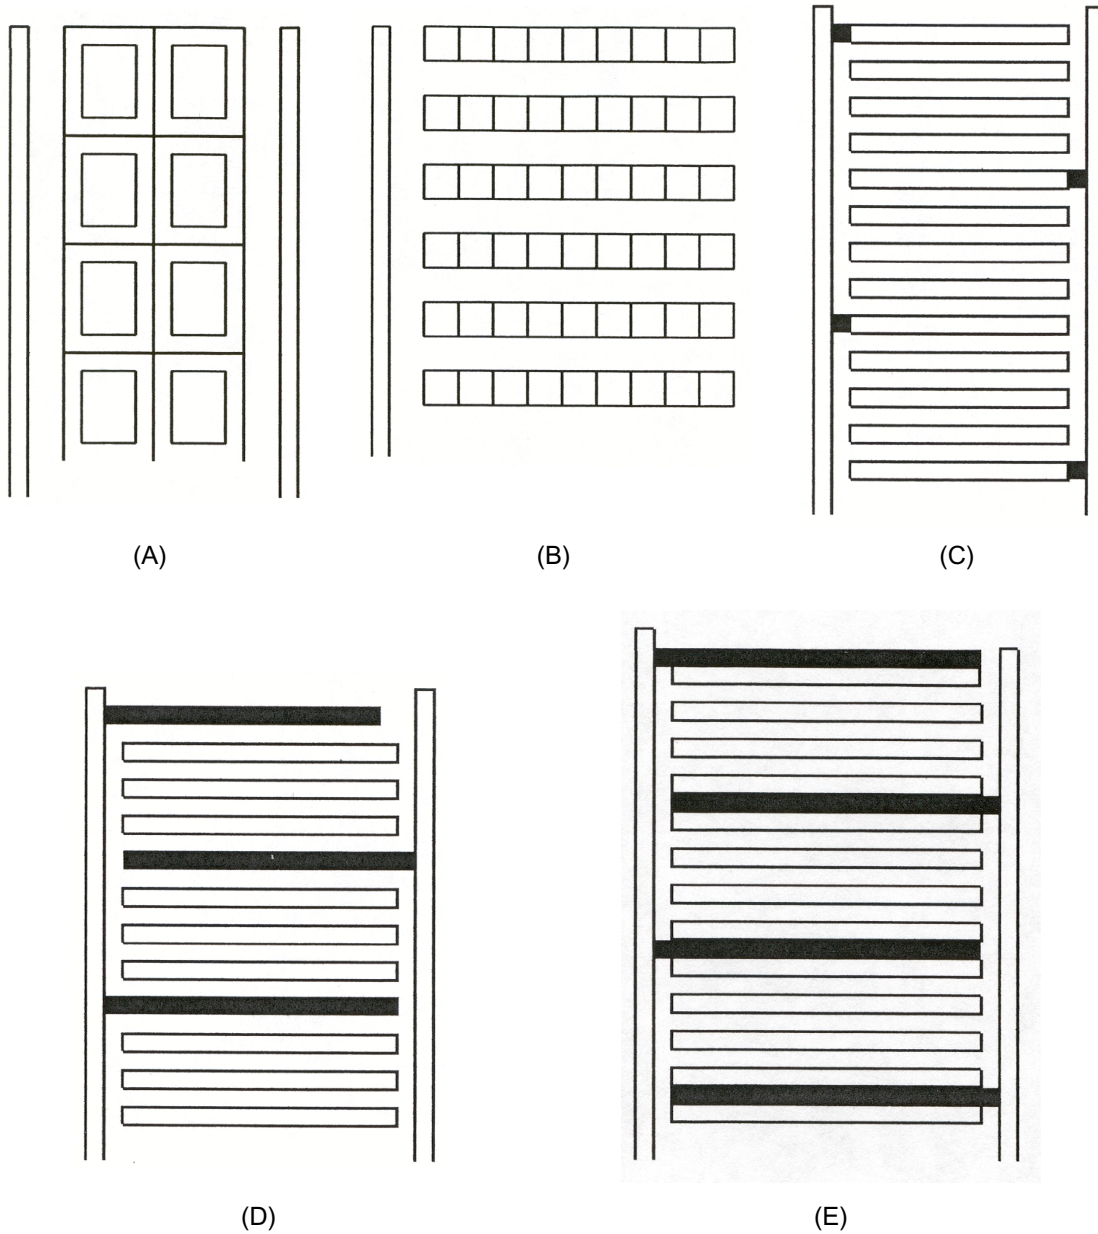


Figure 1—Winding arrangements for core-form power transformers

5.7.1 Layer type windings

The layer type winding illustrated in Figure 1, part (A) consists of turns of wire wound in multiple layers with vertical cooling ducts. Compared with the disc type windings in Figure 1, parts (B) through (E), this winding is simpler to analyze. In addition to variables listed in 5.1–5.6, other factors to consider are

- Flow rates in multiple cooling ducts.
- Multiple layers and multiple cooling ducts that affect the heat flux into each cooling duct. The heat flux from one side of the cooling duct may be different from the other side.

- c) Layer insulation may be a different thickness throughout the winding.
- d) Insulation next to the cooling duct affects the heat transfer.

5.7.2 Disc winding without flow direction

A section of a simple disc winding without flow direction is illustrated in Figure 1, part (B). This winding is used in nondirected flow transformers, where the fluid is not forced to flow through the winding. Pumps may be used to circulate the fluid through the tank and heat exchangers lowering the top fluid temperature in the tank. This also affects the flow rate through the vertical ducts of the winding. The fluid flows through the winding by natural convection. The fluid flow is principally through the vertical ducts with no particular tendency to flow through the horizontal ducts. Slight dimensional variations in the disc sections tend to cause some horizontal fluid flow which is different across each section. Temperature profiles for this configuration are shown in Pierce [B10]. The analysis should take into account fluid flow patterns that result in reduced flow or complete stagnation in some regions. Because of the random nature of the flow, this winding is the most difficult to analyze.

5.7.3 Disc winding with flow direction

To cause flow across the horizontal sections, flow diverting washers or barriers are introduced into the vertical duct to cause the flow to be in a zigzag fashion up the winding. Flow direction within the winding is commonly used on transformers with directed flow and is also used on transformers with nondirected flow. Different schemes are used to introduce the zigzag flow. Some of these schemes are illustrated in Figure 1, parts (C), (D), and (E). There are variations of these schemes and partial flow diversion has been considered.

In the arrangement of Figure 1, part (C) the flow directing barriers are attached to the end strands of the disc section. The loss of the vertical cooling surface for the disc sections with the barrier should be considered. Flow directing washers with cooling ducts above and below the washer may also be used as shown in Figure 1, part (D). Another scheme is illustrated in Figure 1, part (E) where the distance between all disc sections is the same and the flow directing washer is installed in the space between disc sections. The flow directing washer blankets the surface of the conductor and restricts the heat transfer into the fluid and raises the local temperature of the winding conductor. The thermal model should account for this localized heating.

For all these schemes the fluid flow velocity is different between the various disc sections and should be considered. Examples of temperature and velocity profiles are given in Oliver [B62].

5.7.4 Other considerations for power transformers

Local flow restrictions should be considered. Even windings with flow direction may have some local flow restrictions. Regions where leads exit the windings through end blocks should be investigated. The analysis should account for added tape where conductors exit windings; added tape and barriers on leads outside the windings near ground, or through a bushing; extra conductor insulation on end turns; and areas covered by insulation board. Winding conductors exiting through the end insulation may have extra insulation.

5.8 Considerations for distribution and small power transformers

Distribution and small power transformers usually utilize rectangular windings. Some manufacturers may use circular coils for select designs. Fluids other than mineral oil are also used. To minimize the amount of material used and to improve short-circuit strength, the layer insulation contains an adhesive. The portion of the windings under the core iron are pressed and baked to bond the adhesive to the coil conductor and layer insulation. Cooling duct arrangements may differ from power transformers in that not all ducts extend completely around the winding. Some cooling ducts are located only in the portion of the winding outside the core iron typically referred to as “end ducting.” For this reason, some refer to this winding as a “collapsed duct rectangular winding.” To reduce the hottest-spot temperature, some transformers may contain a few

ducts (termed annular ducts) that extend completely around the winding. For these annular ducts to be effective, allowance must be made for fluid to enter and exit the portion of the duct under the core iron.

A quarter section of a winding is illustrated in Figure 2. The winding may consist of a secondary and primary coil assembly. For small distribution transformers, the winding arrangement may consist of an inner secondary winding, primary winding, and an outer secondary winding. The windings are wound tightly over each other with insulation between the windings, although ducts are sometimes used between windings. The space between the inner secondary winding and the core is small and the insulation under the winding may be in contact with the core. The adjacent windings of three-phase units or two-legged single-phase units usually touch and may contact the outer core legs of shell type or three-phase five-legged core-type units. Cores may be either stacked or wound.

The collapsed duct arrangement causes a circumferential temperature gradient from the center of the winding with no ducts under the core iron to the center of the winding outside core iron where cooling ducts are located. In addition, thermal gradients are present between layers. The vertical temperature gradient is due to the oil flow within the cooling ducts and the outer surface of the windings.

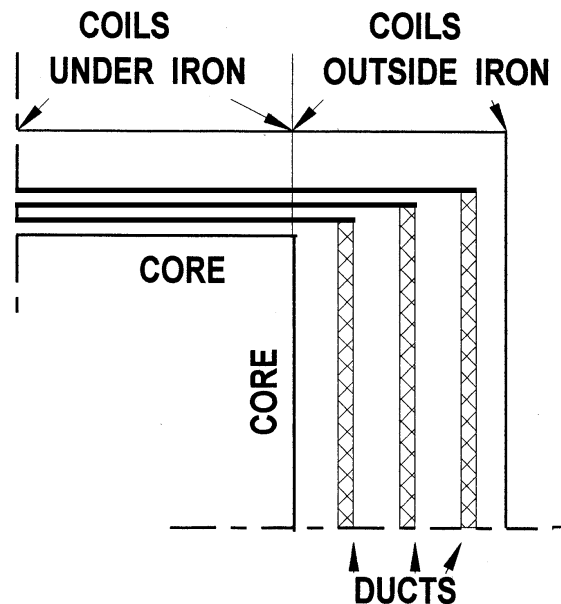


Figure 2—Quarter section of rectangular winding

The following factors should be considered in a winding heat transfer model for distribution or small power transformers:

- Fluid properties (i.e., viscosity, thermal conductivity, coefficient of thermal expansion, density, and specific heat).
- Quantity, location, and size of cooling ducts.
- Heat flux from each side of the cooling duct is different. The heat flux also varies with the particular cooling duct and varies circumferentially along a given duct.
- Heat flow across layers should be considered. Layer insulation thicknesses may vary throughout the winding.
- Circumferential heat flow from the portion of the winding under core iron to the portion of the winding outside core iron should be considered.

- f) Heat flow between the various windings and the core occur and should be considered.
- g) An accurate determination of the dimensions of the various parts of the winding is important to predict temperature rises. To properly allow for conduction heat transfer and loss generation, it is of particular importance to determine the dimensions of the parts of the winding where cooling ducts are not present. Dimensions of the parts of the winding where cooling ducts are located can be easily determined from the dimensions of the cooling duct assemblies.
- h) Layers and turns in the tapped-out parts should be considered.

6. Determination of hottest-spot rise from production thermal tests without direct measurement of hottest-spot temperature

Thermal tests are usually performed without direct measurement of the hottest-spot rise. There are no methods or equations to obtain hottest-spot rise from measurements of fluid temperatures and average winding temperature rise by resistance during standard commercial tests in accordance with IEEE Std C57.12.90-1999. The manufacturer's thermal model and test data using direct measurement on other units may be used to determine the hottest-spot rise from the production thermal test data.

The thermal test data may be used to determine the hottest-spot rise by means of the following equations.

$$H = \frac{\Delta\Theta_{H,*} - \Delta\Theta_{TO,*}}{\Delta\Theta_{W,*} - \Delta\Theta_{AO,*}} \quad (1)$$

$$\Delta\Theta_{AO,T} = \frac{\Delta\Theta_{TO,T} + \Delta\Theta_{BO,T}}{2} \quad (2)$$

$$\Delta\Theta_H = \Delta\Theta_{TO,T} + H[\Delta\Theta_{W,T} - \Delta\Theta_{AO,T}] \quad (3)$$

where

- H is a dimensionless factor whose value is greater than 1.0
- $\Delta\Theta_{AO,T}$ is average fluid rise over ambient for the unit tested, °C
- $\Delta\Theta_{AO,*}$ is average fluid rise over ambient determined by analysis or from tests on similar units, °C
- $\Delta\Theta_{BO,T}$ is bottom fluid rise over ambient for the unit tested, °C
- $\Delta\Theta_{BO,*}$ is bottom fluid rise over ambient determined by analysis or from tests on similar units, °C
- $\Delta\Theta_H$ is winding hottest-spot rise over ambient, °C
- $\Delta\Theta_{H,*}$ is winding hottest-spot rise over ambient determined by analysis or from tests on similar units, °C
- $\Delta\Theta_{TO,T}$ is top fluid rise over ambient for the unit tested, °C
- $\Delta\Theta_{TO,*}$ is top fluid rise over ambient determined by analysis or from tests on similar units, °C
- $\Delta\Theta_{W,T}$ is average winding rise over ambient for the unit tested, °C
- $\Delta\Theta_{W,*}$ is average winding rise over ambient determined by analysis or from tests on similar units, °C

Errors in prior testing using direct measurement of hottest spot can lead to erroneous values of the H-factor. An error on the low side of the average winding rise gradient with an accurate hottest-spot value gives a high value of the H-factor. A measurement error on the low side for the hottest-spot gradient and an accurate value of the average winding gradient gives a low value of the H-factor. Hottest-spot temperature rise measurements less than the average winding rise have been reported with fiber optic detectors. Care should be exercised to correctly measure hottest-spot rise.

Many factors influence the ratio of hottest-spot rise to average winding rise. Many of these factors are described in this guide. By using a combination of mathematical analysis combined with testing using embedded detectors, a manufacturer may develop H-factors for different designs.

This should be acceptable if the H-factor for a specific design is based on the manufacturer's experience from analysis and tests on past designs. It is the manufacturer's responsibility to choose the correct H-factor. Statistical analysis of a number of analyses and tests might be used. The choice of an unrealistic high value penalizes the user in determining loading capability. Unrealistic low values should also be avoided. A discussion of the variation of the H-factor is given in Annex C.

7. Documentation and acceptance criteria

IEEE Std C57.12.00-2000, subclause 5.11.1.1, states, "The maximum (hottest-spot) winding temperature rise above ambient shall be included on the test report with the other temperature rise data. A note shall indicate which of the above methods was used to determine the value." The "above methods" are also listed in 1.2 of this guide. When direct measurements of hottest-spot temperatures are not performed, the manufacturer's thermal model and/or prior tests should be the only criteria to determine the hottest-spot rise. Other methods should only be used by agreement between the manufacturer and purchaser in the purchasing contract.

A detailed report of calculations should not be required to be submitted with the test report. It is expected that manufacturers will incorporate the thermal model as a subroutine in their computer design programs. Some manufacturers may choose as an option to supply additional information from the computer subroutine to further substantiate their performance claims.

Reports describing the manufacturer's thermal program and tests are highly proprietary. Summary reports describing the thermal model and a comparison of the predictions vs. test results should be available for review at the manufacturer's plant or at another location by prior agreement.

Annex A

(informative)

Bibliography on experimental testing to predict or confirm transformer thermal performance

Information on experimental apparatus, procedures, and test data is also given in [B43], [B44], [B45], [B46], [B51], [B56], [B65], [B67], [B68], [B70], [B72], [B74], and [B75] of Annex B. This bibliography is divided into two parts, as follows:

- a) Thermal testing by methods other than fiber optics
- b) Testing by methods using fiber optic temperature detectors

A.1 Testing by methods other than fiber optics

[B1] Aubin, J., Bergeron, R., and Morin, R., “Distribution transformer overloading capability under cold load pickup conditions,” *IEEE Trans. Power Delivery*, vol. 5, pp. 1883–1890, Nov. 1990.

[B2] Aubin, J. and Yanghame, Y., “Effect of oil viscosity on transformer loading capability at low ambient temperatures,” *IEEE Trans. Power Delivery*, vol. 7, no. 2, pp. 516–522, Apr. 1992.

[B3] Douglas, D.H., Lawrence, C.O., and Templeton, J.B., “Factory overload testing of large power transformers,” *IEEE Trans. Apparatus and Systems*, vol. PAS-104, no. 9, pp. 2492–2500, Sept. 1985.

[B4] Godec, Z., and Sarunac, R., “Steady-state temperature rises of ONAN/ONAF/ONAF transformers,” *IEEE Proc.-C*, vol. 135, no. 5, pp. 448–454, Sept. 1992.

[B5] Kunes, J. J., “Characteristics of thermosiphon flow in a model transformer oil circuit,” Part III, *Power Apparatus and Systems, Trans. AIEE*, vol. 77, no. 39, pp. 973–977, Dec. 1958.

[B6] Kurita, S. A., and K. Okuyama, “Practical performance test on 275 kV 680 MVA transformer,” *Hitachi Review*, vol. 25, no. 10, pp. 329–334, 1976.

[B7] Lampe, W., “Power transformers and shunt reactors for arctic regions,” *IEEE Trans. Power Del.*, vol. PWRD-1, no. 1, pp. 217–224, Jan. 1986.

[B8] Northrup, S. D., and Thompson, M. A., “Cold start performance of transformers filled with high molecular weight hydrocarbon liquid,” *IEEE Trans. Power Apparatus and Systems*, vol. PAS-103, no. 11, pp. 3373–3378, Nov. 1984.

[B9] Pierce, L. W., “An investigation of the temperature distribution in cast-resin transformer windings,” *IEEE Trans. Power Delivery*, vol. 7, no. 2, pp. 920–926, April 1992.

[B10] Pierce, L. W., “An investigation of the thermal performance of an oil-filled transformer winding,” *IEEE Trans. Power Delivery*, vol. 7, no. 3, pp. 1347–1358, July 1992.

[B11] Pierce, L. W., “Hottest-spot temperatures in ventilated dry-type transformers,” *IEEE Trans. Power Delivery*, vol. 9, no. 1, pp. 257–264, Jan. 1994.

[B12] Stewart, H. C., and Whitman, L. C., "Hot spot temperatures in dry-type transformer windings," AIEE Trans., vol. 63, pp. 763–768, Oct. 1944.

[B13] Taylor, E. D., Berger, B., and Western, B. E., "An experimental approach to the cooling of transformer coils by natural convection," Proc. IEE, vol. 105A, pp. 141–152, 1958.

A.2 Thermal test methods using fiber optic temperature detectors

[B14] CIGRE, "Group 12 (Transformers Discussion)," Proc. 29th Session, pp.33–37, 1982.

[B15] CIGRE, "Group 12 Discussion," Proc. 30th Session, pp. 1–12, 1984.

[B16] CIGRE Working Group 09 of Study Committee 12, "Direct measurement of the hot-spot temperature of transformers," CIGRE Electra, No. 129, pp. 47–51, Mar. 1990.

[B17] Cosaert, F., Goosens, J., Platteau, C., Leemans, P., and Moolaert, G., "Dynamic analysis of thermal behavior of transformers using optical fibre measurements," CIGRE Paper 12-305, 1992.

[B18] Goto, K., Tsukioka, H., and Mori, E., "Measurement of winding temperature of power transformers and diagnosis of ageing deterioration by detection of CO₂ and CO," CIGRE Paper 12-102, 1990.

[B19] Hampton, B. F., Medhurst, D. R., Rogers, A. J., Woolard, M. E., and Stinton, C. C., "The measurement of transformer winding temperature," CIGRE Paper 12-02, 1982.

[B20] Lampe, W., Pettersson, L., Ovren, C., and Wahlstrom, B., "Hot-spot measurements in power transformers," CIGRE Paper 12-02, 1984.

[B21] Lindgren, S. R., Addis, G. I., Nilsson, S. L., and Petrie, E. M., "Determination of reliable transformer capacity through direct hot spot temperature measurement and safe thermal loading limits," CIGRE Paper 12-104, 1990.

[B22] McNutt, W. J., McIver, J. C., Snow, R. V. and Fallon, D. J., "Transformer loading capability information derived from winding hot spot measurements," CIGRE Paper 12-08, 1984.

[B23] McNutt, W. J., McIver, J. C., Fallon, D. J., and Wickersheim, K. A., "Direct measurement of transformer winding hot spot temperature," IEEE Trans. Power Apparatus and Systems, vol. PAS-103, no. 6, pp.1155–1162, June 1984.

[B24] Nordman, H., Hironniemi, E., and Pesonen, A. J., "Determination of hot-spot temperature rise at rated load and at overload," CIGRE Paper 12-103, 1990.

[B25] Norton, E. T., and Wickersheim, K. A., "Improved fiberoptic temperature measurement systems for monitoring winding temperatures in medium and large transformers," IEEE Trans. Power Del. vol. PWRD-2, no. 3, pp. 831–835, July 1987.

[B26] Poittevin, J., Samat, J., Henneblque, I., and Tanguy, A., "Direct fibre-optic hot-spot temperature measurement in an operating transformer," CIGRE Paper 12-106, 1990.

[B27] Thaden, M. V., Mehta, S., P., Tuli, S. C., and Grubb, R. L., "Temperature rise tests on a forced-oil-air cooled (FOA) (OFAF) core-form transformer, including loading beyond nameplate," IEEE Trans. Power Del., vol. 10, no. 2, pp. 913–919, April 1995.

[B28] Troisi, J. F., "Experience with fiber optic hot-spot sensor in 450 MVA SMIT autotransformer," Proc. 1992 Doble Conference.

[B29] White, A., Daniels, M. R., Bibby, G., and Fisher, S., "Thermal assessment of transformers," CIGRE Paper 12-105, 1990.

[B30] Zodeh, O. M., and Whearty, R. J., "Thermal characteristics of a meta-aramid and cellulose insulated transformer at loads beyond nameplate," IEEE Trans. Power Del., vol. 12, no. 1, pp. 234–245, Jan. 1997.

Annex B

(informative)

Bibliography on modeling of transformer thermal performance

This bibliography was compiled to assist in development of mathematical models to predict the thermal performance of transformers. Finite difference methods are described in many sources on heat transfer. The book by Thomas [B33] is a modern reference. Schenck [B31] is listed because implementation in computer programs is described. The references on conduction analysis have limited application for large distribution or power transformers. They could be useful for very small transformers and were listed to give a comprehensive bibliography. References on mathematical modeling of other than liquid filled transformers were included because the techniques could be applicable to all types of transformers. These references may also include experimental methods. References on modeling of transformers cooled by two phase flow were not included because of the uniqueness of the heat transfer mechanism.

B.1 Finite difference methods

[B31] Schenck, H., Jr., *Fortran Methods in Heat Flow*, New York: Ronald Press Company, pp. 1–92, 1963.

[B32] Schneider, P.J., “Temperature fields in electrical coils: Numerical solutions,” *AIEE Trans. Communications and Electronics*, pp. 768–771, Jan. 1954.

[B33] Thomas, L. C., *Heat Transfer Professional Version*, Englewood Cliffs, NJ: Prentice Hall, 1993, pp. 171–231, 976.

B.2 Conduction analysis

[B34] Cooper, H. F., “Transient and steady state temperature distribution in foil wound solenoids and other electric apparatus of rectangular cross section,” 1965 IEEE International Convention Record, Part 10, pp. 67–75, March 1965.

[B35] Cooper, H. F., Jr., “Joule heating of an infinite rectangular rod with orthotropic thermal properties,” *ASME J. Heat Transfer*, vol. 89, no. 1, pp. 39–43, Feb. 1967.

[B36] Higgins, T. J., “Formulas for calculating the temperature distribution in electrical coils of general rectangular cross section,” *ASME Trans.*, pp. 665–670, 1944.

[B37] Higgins, T. J., “Formulas for calculating temperature distribution in transformer cores and other electrical apparatus of rectangular cross section,” *AIEE Trans. Elec. Eng.*, vol. 64, pp. 190–194, Apr. 1945.

[B38] Higgins, T. J., “Temperature distribution in toroidal electrical coils of rectangular cross section,” *Journal of Franklin Institute*, vol. 240, pp. 97–112, Aug. 1945.

[B39] Jakob, M., “Influence of nonuniform development of heat upon the temperature distribution in electrical coils and similar heat sources of similar form,” *ASME Trans.*, pp. 593–605, 1943.

[B40] Kofman, L. B., “The two dimensional temperature fields in the winding of a low power transformer in a steady state thermal mode,” *The Academy of Sciences of the USSR, Power Engineering*, vol 15, no. 1, pp. 132–138, 1977.

B.3 Liquid-immersed transformers

[B41] Allen, P. H. G., and Allan, D. J., "Layer-type transformer winding cooling factors derived from analogue solution of governing equations," *Proc. IEE*, vol. 110, no. 3, pp. 523–534, Mar. 1963.

[B42] Allen, P. H. G., and Allan, D. J., "The solution of a complex thermal problem by hybrid computation," *Proc. 4th International Analogue computation Meeting, Brighton, England*, pp. 500–505, 1964.

[B43] Allen, P. H. G., and Childs, E. D., "Conjugated heat transfer in disc type power transformer windings," *Proc. 8th Int. Heat Transfer Conf.*, vol. 6, pp. 2977–2982, 1986.

[B44] Allen, P. H. G., and Finn, A. H., "Transformer winding thermal design by computer," *IEE Conference Publication*, no. 51, pp. 589–599, 1969.

[B45] Allen, P. H. G., Szpiro, O., and Campero, E., "Thermal analysis of power transformer windings," *Electric Machines and Electromechanics*, vol. 6, pp. 1–11, 1981.

[B46] Burton, P. J., Graham, J., and Hall, A. C., "Recent developments by CEGB to improve the prediction and monitoring of transformer performance," *CIGRE Paper 12-09*, 1984.

[B47] Childs, E. P., "Flow maldistribution in disc-type power transformer windings," in *Maldistribution of Flow and Its Effect on Heat Exchanger Performance*, presented at 24th National Heat Transfer Conf. and Exhibition, 9–12 Aug. 1997, Pittsburgh, Pa., *ASME HTD*, vol. 75, pp. 137–143.

[B48] Declercq, J., and Van der Veken, W., "Accurate hot spot modeling in a power transformer leading to improved design and performance," *Proc. 1999 IEEE/PES Transmission and Distribution Conference*, 11–17 April 1999, New Orleans, La.

[B49] Del Vecchio, R. M., and Feghali, P., "Thermal model of a disc coil with directed oil flow," *Proc. 1999 IEEE/PES Transmission and Distribution Conference*, 11–17 April 1999, New Orleans, La.

[B50] Eastgate, C., "Simplified steady state thermal calculations for naturally cooled transformers," *IEE Proc.*, vol. 112, no. 6, pp. 1127–1134, June 1965.

[B51] Grub, R. L., Hudis, M., Traut, A. R., "A transformer thermal duct study of various insulating fluids," *IEEE Trans. Power Apparatus and Systems*, vol. PAS-100, no. 2, pp. 466–473, Feb. 1981.

[B52] Imre, L., "Determination of the steady state temperature distribution of transformer windings by the heat flux network method," *Periodica Polytechnica, Electrical Engineering*, vol. 20, pp. 461–471, 1976.

[B53] Imre, L., Bitai, A., and Csenyi, P., "The role of the characteristic parameters in the warming of oil transformers," *Periodica Polytechnica, Electrical Engineering*, vol. 23, pp. 293–300, 1979.

[B54] Imre, L., Bitai, A., and Csenyi, P., "Parameter sensitivity investigations of the warming of oil transformers," *Proc. First International Conf. Numerical Methods in Thermal Problems*, pp. 850–858, 2–6 July 1979.

[B55] Imre, L., Bitai, A. and Csenyi, P., "Thermal transient analysis of OFAF transformers by numerical methods," *Proc. 2nd. International Conf. On Numerical Methods In Thermal Problems, Venice, Italy*, pp. 899–901, 7–10 July 1981.

[B56] Imre, L., Bitai, B., and Palkovics, S., "Heat transfer and flow characteristics of large oil transformer windings," *Proc. Eighth Int. Heat Transfer Conf.*, San Francisco, vol. 6, pp. 2989–2994, Aug. 1986.

[B57] Imre, L., Szabo, I., and Bitai, A., "Determination of the steady state temperature field in naturally oil cooled disc type transformers," Int. Heat And Mass Transfer Conf., Toronto, Ontario, Canada, vol. 2, pp. 123–128, 1978.

[B58] Kiss, L., Szita, I., and Ujhazy, G., "Some characteristic design problems of large power transformers," CIGRE Paper 12-07, 1974.

[B59] Kiss, L., "Temperature rise and cooling of transformers," Chapter 6 of *Large Power Transformers*, K. Karsai, D. Kerényi, and L. Kiss, New York: Elsevier, pp. 351–535, 1987.

[B60] Mikhailovsky, Y.A., Shvidler, A. B., Tarle, G. E., Tchornogotsky, V. M., Voevodin, I. D., and Lyublin, I. S., "Methods of temperature rise calculation of power transformer windings," CIGRE Paper 12-16, 1984.

[B61] Muur, S., "On the modes of oil flow in self cooled transformers and the associated temperature distributions," CIGRE Paper, No.125, vol. II, 1962.

[B62] Oliver, A. J., "Estimation of transformer winding temperatures and coolant flows using a general network method," IEE Proc. vol. 127, pt. C, no. 6, pp. 395–405, Nov. 1980.

[B63] Pierce, L. W., and Holifield, T., "A thermal model for optimized distribution and small power transformer design," Proc. 1999 IEEE/PES Transmission and Distribution Conference, New Orleans, La., pp. 925–930, 11–17 April 1999.

[B64] Pivrnec, M., Allen, P. H. G., and Havlicek, K., "Calculation of the forced directed oil-circulation rate through a transformer cooling system," IEE Proc., vol. 134 pt. C, no. 4, pp. 306–312, July 1987.

[B65] Preiningerova, V., Kahoun, V., and Dolezel, I., "Thermal analysis of large oil-immersed transformer windings," *Electrical Machines and Power Systems*, vol. 8, no. 2, pp. 89–102, Mar.–Apr. 1983.

[B66] Preiningerova, V., and Korinek, S., "Digital computation of heat transfer in layer-type transformer windings," S.N.T.L. Technical Digest, no. 9, pp. 683–688, 1967.

[B67] Preiningerova, S. V. and Pivrnec, M., "Temperature distribution in the coil of a transformer winding," Proc. IEE, vol. 124, no. 3, pp. 218–222, Mar. 1977.

[B68] Szpiro, O., Allen, P. H. G., and Richards, C. W., "Coolant distribution in disc type transformer windings horizontal ducts and its influence on coil temperatures," Proc. 7th Int. Heat Transfer Conf., vol. 6, pp. 251–256, 1982.

[B69] Venkateswarlu, P., and Prasad, A. R., "Numerical prediction of the temperature distribution in the coils of a transformer winding," CIGRE Paper 12-04, 1984.

[B70] Yamaguchi, M., Kumasaka, T., Inui, Y., and Ono, S., "The flow rate in a self cooled transformer," IEEE Trans. Power Apparatus and Systems, vol. PAS-100, no.3, pp. 956–963, Mar. 1981.

B.4 Ventilated dry type transformers

[B71] Halacsy, A. A., "Temperature rise of dry type transformers," AIEE Trans., vol. 77, pt. III, Power Apparatus and Systems, no. 37, pp. 456–462, Aug. 1958.

[B72] Pierce, L.W., "Predicting hottest-spot temperatures in ventilated dry type transformers," IEEE Transactions Power Del., vol. 9, no. 2, pp. 1160–1172, Apr. 1994.

B.5 Cast resin transformers

[B73] Costa, A. F. and Guedes, M. V., "Provision of the thermal behavior of dry-type cast resin transformers," *Electrical Machines and Power Systems*, vol. 20, no. 3, pp. 261–272, May/June 1992.

B.6 Gas insulated transformers

[B74] Nakadate, M., Toda, K., Sato, K., Biswas, D., Nakagawa, C., and Yanari, T., "Gas cooling performance in disc-winding of large capacity gas-insulated transformer," *IEEE Trans. Power Del.*, vol. 11, no. 2, pp. 903–908, Apr. 1996.

[B75] Sato, T., Ina, T., and Matsumoto, M., "Cooling effect by gas density of SF₆ insulated transformers," *IEEE Trans. Power Apparatus and Systems*, vol. PAS-101, no. 7, pp. 2229–2235, July, 1982.

B.7 Heating of transformer cores

[B76] Cockcroft, J.D., "The temperature distribution in a transformer or other laminated core of rectangular cross section in which heat is generated at a uniform rate," *Proc. Cambridge Philosophical Society*, vol. 22, pp. 759–772, July 1925.

[B77] Morris, A.L., "Thermal rating of fluid cooled transformer cores," *The Engineer*, vol. 201, no. 5221, pp. 216–218, 17 Feb. 1956.

[B78] Rele, A. and Palmer, S., "Cooling of large transformer cores" *IEEE Trans. Power Apparatus and Systems*, vol. 91, pp. 1527–1535, 1972.

Annex C

(informative)

Determination of hottest-spot rise from tests without direct measurement

C.1 Introduction

It would be desirable if the hottest-spot rise could be determined from measurements of fluid temperatures and average winding rise by resistance during standard commercial tests in accordance with IEEE Std C57.12.90-1999. Two methods have been proposed, the “multiflow method,” and the “IEC method.” The “multiflow” method was based on considerations of oil flow within the winding. The “IEC method” is based on a consideration for the higher eddy losses at the top of the winding.

C.2 Multiflow method

The multiflow method to determine hottest-spot rise was first proposed by Carruthers and Norris [B81]. They proposed that the hottest-spot rise could be determined from the following equations:

For ON cooling

$$\Delta\Theta_h = 1.1\Delta\Theta_r - 1.1\Delta\Theta_{mwo} + \Delta\Theta_{to} \quad (\text{C.1})$$

For OF and OD cooling

$$\Delta\Theta_h = 1.1\Delta\Theta_r + 0.9\Delta\Theta_{mwo} - \Delta\Theta_{bo} \quad (\text{C.2})$$

where

$\Delta\Theta_r$ is temperature rise of a winding by resistance

$\Delta\Theta_{mwo}$ is average temperature rise of oil inside winding ducts

$\Delta\Theta_{to}$ is top oil temperature rise

$\Delta\Theta_{bo}$ is bottom oil temperature rise

It was assumed and proposed that the average oil rise inside the winding ducts could be obtained from the asymptotic value of the winding cooling curve. Others have proposed that it could be obtained directly by inserting probes into the winding ducts.

Direct measurement data using fiber optic detectors presented by Lampe [B86] and Lampe [B84] showed considerable deviation from values calculated using the multiflow method.

C.3 IEC method

Equations for estimating the hottest-spot temperature rise at steady state for loads above rating were given in the IEC Loading Guide 354 [B93]. Although these are only estimating equations, they are commonly called

“The IEC method” in the United States. It does *not* appear in the IEC performance standard IEC 60076-2 (1993-04) [B92] as an approved method or requirement to calculate winding hottest-spot temperature rise. It is however discussed in a subclause of an informative Annex B whose title is “Transient loading—mathematical model and testing.” In IEEE Std C57.12.00-2000, it is required that the hottest-spot rise not exceed 80 °C. There is no requirement in IEC 60076-1 (1993-03) [B91] or IEC 60076-2 (1993-04) [B92] to meet a specified hottest-spot temperature rise. Since there is no IEC performance requirement for hottest-spot temperature rise, the purpose of the information in Annex B of IEC 60076-2 (1993-04) [B92] and IEC 60354 (1991-10) [B93] is to provide information for user calculations of loading capability. Users of transformers manufactured to IEEE Std C57.12.00-2000, could use 80 °C for the rated hottest-spot rise in their loading calculations. It is a misconception that the so-called “IEC method” is an approved IEC method to determine the hottest-spot rise for the purposes of complying with performance requirements.

For natural flow, the IEC equation is based on multiplying the difference in average winding rise and average oil rise by an H-factor and then adding it to the top oil rise. For forced oil transformers, it is based on multiplying the difference in average winding rise and average oil rise in the winding by an H-factor and then adding it to the bottom oil rise and the oil rise at the top of the winding ducts. The oil rise in the winding duct is determined from the asymptotic value of the winding cooling curve. The H-factor is to allow for the higher eddy loss at the end of the winding.

To prepare typical loading tables, the 1991 edition of IEC 60354 (1991-10) [B93] assumed a factor of 1.1 for distribution transformers and 1.3 for power transformers. Annex B of IEC 60076-2 (1993-04) [B92] states, “In large transformers there is considerable variation depending on design, and the manufacturer should be consulted for information, unless actual measurements are carried out...”

A 1995 CIGRE Electra article [B89] giving experimental results using fiber optic data showed that the hot spot factor ranged from 0.51 to 2.06. Values less than 1.0 are an obvious error. Although the mean value for power transformers was close to 1.3 the conclusion was that the factor cannot be represented by a single constant. The conclusions stated

“A utility with no overload specification that wants to use the loadability of its new transformers therefore has two choices:

- Measure the hot spot directly and, in the case of similar transformers, devise a thermal model of the hot-spot according to the design.
- Use the manufacturer’s calculated value deduced from knowledge of his design.”

A companion 1995 CIGRE Electra article [B90] described attempts to determine analytically the H-factor based on electromagnetic concepts. The study group concluded that it was not reasonable to recommend any formula for the H-factor.

Calculations of the H-factor for distribution transformers given in Pierce and Holifield [B63] showed a range from 1.018 to 1.741 for ratings from 15 kVA single phase through 2500 kVA three phase.

C.4 Summary

The two methods described in this Annex gave variations between test and calculation by using a single value of the constants in the equations. The multiflow method considered the variable of variation of oil temperature and the IEC concept was based on considerations of eddy loss variation and oil temperature at the top of the winding. Equation (1), Equation (2), and Equation (3) of this guide with a variable H-factor were proposed as a suitable method. This should be acceptable if the H-factor for a specific design is based on the manufacturer’s experience from analysis and tests on past designs.

C.5 Bibliography for Annex C

C.5.1 Multiflow method

[B79] Allen, P. H. G., "Transformer rating by hottest spot temperature, the problems and possibilities of using the 'multiflow' oil cooling principle are examined," *Electrical Times*, pp. 33–38, 12 Mar. 1971.

[B80] Allen, P.H.G., "Discussion of E. T. Norris: The thermal rating of transformers," *Proc. IEE*, vol. 114 pp. 1758–1759, Nov. 1967.

[B81] Carruthers, M. G. and Norris, E. T., "Thermal ratings of transformers introduction of multiflow principle," *Proc. IEE*, vol. 116, no. 9, pp. 1564–1570, 1969.

[B82] CIGRE, "Group 12 (Transformers) Discussion," CIGRE, pp.1–20, 1972.

[B83] De Kuijper, C. E. M., "Design, tests, and service considerations associated with temperature rise and temperature distribution in transformers," CIGRE Paper 12-04, 1972.

[B84] Lampe, W., "CIGRE Group 12 Discussion," p. 7, 1984.

[B85] Lampe, W., Persson, B. G., and Carlsson, T., "Hot-spot and top-oil temperatures proposal for a modified heat specification for oil immersed power transformers," CIGRE Paper 12-02, 1972.

[B86] Lampe, W., Pettersson, L., Ovren, C., and Wahlstrom, B., "Hot-spot measurements in power transformers," CIGRE Paper 12-02, p. 5, 1984.

[B87] Norris, E.T., "Thermal rating of transformers-application of multiflow principle to naturally cooled transformers," *IEE Proc.* vol. 118, no. 11, pp. 1625–1629, Nov. 1971.

[B88] Norris, E.T., "Transformer multiflow hottest-spot rating: proposed standard specification," *IEE Proc.* vol. 121, no. 8 pp. 840–844, Aug. 1974.

C.5.2 IEC method

[B89] CIGRE Working Group 09 (Thermal Aspect of Transformers) of Study Committee 12, "Experimental determination of power transformer hot-spot factor," CIGRE technical brochure, no. 96, pp. 125–134.

[B90] CIGRE Working Group 09 of Study Committee 12, "Analytical determination of transformer windings hot-spot factor," CIGRE *Electra*, no. 161, Aug.1995.

[B91] IEC 60076-1 (1993-03), Power transformers—Part 1: General

[B92] IEC 60076-2 (1993-04), Power transformers—Part 2: Temperature rise.

[B93] IEC 60354 (1991-10), Loading guide for power transformers.