

C57.12.32™

IEEE Standard for Submersible Equipment—Enclosure Integrity

IEEE Power Engineering Society

Sponsored by the
Transformers Committee



Published by
The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA

7 March 2003

Print: SH95029
PDF: SS95029

Recognized as an
American National Standard (ANSI)

IEEE Std C57.12.32™-2002

IEEE Standard for Submersible Equipment—Enclosure Integrity

Sponsor

**Transformers Committee
of the
IEEE Power Engineering Society**

Approved 12 September 2002

IEEE-SA Standards Board

Abstract: *Evaluation and testing of the coating integrity of carbon steel and copper bearing steel enclosures used with submersible electrical equipment are covered.*

Keywords: *coating integrity, enclosure integrity, submersible equipment, switches, transformers*

*The Institute of Electrical and Electronics Engineers, Inc.
3 Park Avenue, New York, NY 10016-5997, USA*

*Copyright © 2003 by the Institute of Electrical and Electronics Engineers, Inc.
All rights reserved. Published 7 March 2003. Printed in the United States of America.*

National Electrical Safety Code and NESC are registered trademarks and service marks of the Institute of Electrical and Electronics Engineers, Inc.

*Print: ISBN 0-7381-3379-5 SH95029
PDF: ISBN 0-7381-3380-9 SS95029*

No part of this publication may be reproduced in any form, in an electronic retrieval system or otherwise, without the prior written permission of the publisher.

IEEE Standards documents are developed within the IEEE Societies and the Standards Coordinating Committees of the IEEE Standards Association (IEEE-SA) Standards Board. The IEEE develops its standards through a consensus development process, approved by the American National Standards Institute, which brings together volunteers representing varied viewpoints and interests to achieve the final product. Volunteers are not necessarily members of the Institute and serve without compensation. While the IEEE administers the process and establishes rules to promote fairness in the consensus development process, the IEEE does not independently evaluate, test, or verify the accuracy of any of the information contained in its standards.

Use of an IEEE Standard is wholly voluntary. The IEEE disclaims liability for any personal injury, property or other damage, of any nature whatsoever, whether special, indirect, consequential, or compensatory, directly or indirectly resulting from the publication, use of, or reliance upon this, or any other IEEE Standard document.

The IEEE does not warrant or represent the accuracy or content of the material contained herein, and expressly disclaims any express or implied warranty, including any implied warranty of merchantability or fitness for a specific purpose, or that the use of the material contained herein is free from patent infringement. IEEE Standards documents are supplied “**AS IS.**”

The existence of an IEEE Standard does not imply that there are no other ways to produce, test, measure, purchase, market, or provide other goods and services related to the scope of the IEEE Standard. Furthermore, the viewpoint expressed at the time a standard is approved and issued is subject to change brought about through developments in the state of the art and comments received from users of the standard. Every IEEE Standard is subjected to review at least every five years for revision or reaffirmation. When a document is more than five years old and has not been reaffirmed, it is reasonable to conclude that its contents, although still of some value, do not wholly reflect the present state of the art. Users are cautioned to check to determine that they have the latest edition of any IEEE Standard.

In publishing and making this document available, the IEEE is not suggesting or rendering professional or other services for, or on behalf of, any person or entity. Nor is the IEEE undertaking to perform any duty owed by any other person or entity to another. Any person utilizing this, and any other IEEE Standards document, should rely upon the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

Interpretations: Occasionally questions may arise regarding the meaning of portions of standards as they relate to specific applications. When the need for interpretations is brought to the attention of IEEE, the Institute will initiate action to prepare appropriate responses. Since IEEE Standards represent a consensus of concerned interests, it is important to ensure that any interpretation has also received the concurrence of a balance of interests. For this reason, IEEE and the members of its societies and Standards Coordinating Committees are not able to provide an instant response to interpretation requests except in those cases where the matter has previously received formal consideration.

Comments for revision of IEEE Standards are welcome from any interested party, regardless of membership affiliation with IEEE. Suggestions for changes in documents should be in the form of a proposed change of text, together with appropriate supporting comments. Comments on standards and requests for interpretations should be addressed to:

Secretary, IEEE-SA Standards Board
445 Hoes Lane
P.O. Box 1331
Piscataway, NJ 08855-1331
USA

Note: Attention is called to the possibility that implementation of this standard may require use of subject matter covered by patent rights. By publication of this standard, no position is taken with respect to the existence or validity of any patent rights in connection therewith. The IEEE shall not be responsible for identifying patents for which a license may be required by an IEEE standard or for conducting inquiries into the legal validity or scope of those patents that are brought to its attention.

Authorization to photocopy portions of any individual standard for internal or personal use is granted by the Institute of Electrical and Electronics Engineers, Inc., provided that the appropriate fee is paid to Copyright Clearance Center. To arrange for payment of licensing fee, please contact Copyright Clearance Center, Customer Service, 222 Rosewood Drive, Danvers, MA 01923 USA; +1 978 750 8400. Permission to photocopy portions of any individual standard for educational classroom use can also be obtained through the Copyright Clearance Center.

Introduction

(This introduction is not part of IEEE Std C57.12.32-2002, IEEE Standard for Submersible Equipment—Enclosure Integrity.)

The Accredited Standards Committee on Transformers, Regulators, and Reactors, C57, has for a number of years been developing and correlating standards on these products. The data used in this work have been gathered from many sources, including the standards of the Institute of Electrical and Electronics Engineers and the National Electrical Manufacturers Association, reports of committees of the Edison Electric Institute, and others.

This IEEE standard is a voluntary consensus standard. Its use becomes mandatory only when required by a duly constituted legal authority or when specified in a contractual relationship. To meet specialized needs and to allow innovation, specific changes are permissible when mutually determined by the user and the producer, provided such changes do not violate existing laws and are considered technically adequate for the function intended.

This standard was originally prepared by the Joint C57/C37 Working Group on Enclosures with J. Martin and then R. C. Olen as chair. This group is now the Enclosure Integrity Working Group of the IEEE Transformers Committee.

At the time this standard was completed, the Enclosure Integrity Working Group had the following membership:

D. H. Mulkey, *Co-Chair*

R. C. Olen, *Co-Chair*

Joseph Carulli
Jack Delk
Thomas Diamantis
Ken Elliott
Phillip Fahey

Ali Ghafourian
George Henry
Joseph Martin
Carl Niemann
H. Jin Sim
Edward Smith

Ronald J. Stahara
Alan Traut
Alan Wilks
Al Worland
Dan Ziolkowski

The following members of the balloting committee voted on this standard. Balloters may have voted for approval, disapproval, or abstention.

Samuel Aguirre
David Aho
Glenn Andersen
Edward Bertolini
John Borst
Tommy Cooper
Jerry Corkran
Michael Culhane
Gary Engmann
Jorge Fernandez
Dudley Galloway
Eduardo García
David Gilmer
Randall Groves
Ken Hanus

Michael Hardin
George Henry
Edward Horgan
James D. Huddleston, III
Gael Kennedy
Donald Lowe
Gregory Luri
William Maguire
Fortin Marcel
John Matthews
Gary Michel
Dan H. Mulkey
Ray Nicholas
Robert Olen
Gerald Paiva

Dhiru Patel
Thomas Pekarek
Paul Pillitteri
Robert Plaster
James Ruggieri
James Smith
Ronald J. Stahara
Ronald Stoner
John Teixeira
Giuseppe Termine
Alan Traut
Joseph Tumidajski
Alan Wilks
James Wilson
Bill Wimmer

When the IEEE-SA Standards Board approved this standard on 12 September 2002, it had the following membership:

James T. Carlo, *Chair*
James H. Gurney, *Vice Chair*
Judith Gorman, *Secretary*

Sid Bennett
H. Stephen Berger
Clyde R. Camp
Richard DeBlasio
Harold E. Epstein
Julian Forster*
Howard M. Frazier

Toshio Fukuda
Arnold M. Greenspan
Raymond Hapeman
Donald M. Heirman
Richard H. Hulett
Lowell G. Johnson
Joseph L. Koepfinger*
Peter H. Lips

Nader Mehravari
Daleep C. Mohla
William J. Moylan
Malcolm V. Thaden
Geoffrey O. Thompson
Howard L. Wolfman
Don Wright

*Member Emeritus

Also included are the following nonvoting IEEE-SA Standards Board liaisons:

Alan Cookson, *NIST Representative*
Satish K. Aggarwal, *NRC Representative*

Noelle D. Humenick
IEEE Standards Project Editor

Contents

1. Overview.....	1
1.1 Scope.....	1
1.2 Purpose.....	1
2. References.....	1
3. Definitions.....	2
4. Enclosure design and coating system requirements.....	3
4.1 Enclosure design requirements objective.....	3
4.2 Substrate requirements.....	4
4.3 Coating system requirements.....	4
4.4 Coating system test specimens.....	4
4.5 Coating system performance requirements.....	5
5. General.....	6
5.1 Shipment.....	6
5.2 Coating repair procedure.....	6
5.3 Installation—maintenance of coating integrity.....	6
Annex A (informative) QUV and SCAB procedure.....	7
Annex B (informative) Bibliography.....	10

IEEE Standard for Submersible Equipment—Enclosure Integrity

1. Overview

1.1 Scope

This standard covers conformance tests and requirements for the integrity of carbon steel and copper bearing steel submersible electrical enclosures intended for installation in submerged or partially submerged environments. These enclosures contain apparatus energized in excess of 600 V (with the exception of network protectors) that may be exposed to the public, including but not limited to, the following types of equipment enclosures:

- a) Submersible distribution transformers
- b) Submersible network transformers
- c) Submersible network protectors
- d) Submersible switchgear
- e) Submersible capacitors or inductors
- f) Submersible junction enclosures
- g) Submersible metering equipment

1.2 Purpose

The purpose of this standard is to describe the requirements for a comprehensive integrity system for submersible enclosures providing long field life with minimum maintenance.

2. References

This standard shall be used in conjunction with the following standards. When the following standards are superseded by an approved revision, the revision shall apply.

ASTM A242-01, Standard Specification for High-Strength Low-Alloy Structural Steel.¹

¹ASTM publications are available from the American Society for Testing and Materials, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959, USA (<http://www.astm.org/>).

ASTM A588-01, Standard Specification for High-Strength Low-Alloy Structural Steel with 50 ksi [345 MPa] Minimum Yield Point to 4-in [100 mm] Thick.

ASTM B117-97, Standard Practice for Operating Salt Spray (Fog) Apparatus.

ASTM D714-87 (2000), Standard Test Method for Evaluating Degree of Blistering of Paints.

ASTM D1654-92 (2002), Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments.

ASTM D2794-93 (2000-e1), Standard Test Method for Resistance of Organic Coatings to the Effects of Rapid Deformation (Impact).

ASTM D3170-01, Standard Test Method for Chipping Resistance of Coatings.

ASTM D3359-02, Standard Test Methods for Measuring Adhesion by Tape Test.

ASTM D3363-00, Standard Test Method for Film Hardness by Pencil Test.

ASTM D4587-01, Standard Practice for Fluorescent UV-Condensation Exposures of Paint and Related Coatings.

ASTM G154-00 (ae1), Standard Practice for Operating Fluorescent Light Apparatus for UV Exposure of Nonmetallic Materials.

NACE RP 01 88-99, Discontinuity (Holiday) Testing of New Protective Coatings.²

SAE J400-2001, Test for Chip Resistance of Surface Coatings.³

3. Definitions

For the purposes of this standard, the following terms and definitions apply. IEEE 100™ [B8] should be referenced for terms not defined in this clause.⁴

3.1 carbon steel: A steel containing only residual quantities of elements other than carbon, except those added for deoxidation or to counter the deleterious effects of residual sulfur. Silicon is usually limited to about 0.60% and manganese to about 1.65%. Also termed plain carbon steel, ordinary steel, or straight carbon steel. See Bringas and Wayman [B7].

3.2 conformance tests: Certain performance tests are conducted to demonstrate compliance with the applicable standards. The test specimen is normally subjected to all planned routine tests prior to initiation of the conformance test program.

NOTE—The conformance tests may or may not be similar to certain design tests. Demonstration of margins (capabilities) beyond the standard requirements is unnecessary.

²NACE standards are available from National Association of Corrosion Engineers, PO Box 218340, Houston, TX 77218.

³SAE publications are available from the Society of Automotive Engineers, 400 Commonwealth Drive, Warrendale, PA 15096, USA (<http://www.sae.org/>).

⁴The numbers in brackets correspond to those of the bibliography in Annex B.

3.3 copper bearing steel: Carbon steel with approximately 0.15% carbon, 0.05% maximum sulfur, and a minimum of 0.2% copper content, exhibiting a minimum yield strength of 345 MPa and suitable for welding.⁵ ASTM A242-01 and ASTM A588-01 describe such steels in detail. Also known as copper iron.

3.4 design tests: Tests made by the manufacturer to determine the adequacy of the design of a particular type or model of equipment or its component parts in order to meet its assigned ratings and to operate satisfactorily under normal conditions and under special conditions if specified. These tests may be used to demonstrate compliance with applicable standards of the industry.

NOTE—Design tests, sometimes called type tests, are made on representative apparatus or prototypes to verify the validity of design analysis and calculation methods and to substantiate the ratings assigned to all other apparatus of basically the same design. These tests may also be used to evaluate the modification of a previous design and to ensure that performance has not been adversely affected. Test data from previous similar designs may be used for current designs, where appropriate. Once made, the tests need not be repeated unless the design is changed so as to modify performance.

3.5 dry thickness: Thickness of any applied coating(s) measured after curing.

3.6 Harrison's solution: Harrison's solution is made by dissolving 3.5 g ammonium sulfate and 0.05 g sodium chloride in 1 L of potable tap water.

3.7 routine tests: Tests made for quality control by the manufacturer on every device or representative samples or on parts or materials as required to verify during production that the product meets the design specifications and applicable standards.

NOTES

1—Certain quality assurance tests on identified critical parts of repetitive high-production devices may be tested on a planned statistical sampling basis.

2—"Routine tests" are sometimes called "production tests."

3.8 submersible enclosure: An enclosure containing electrical apparatus, typically located outdoors below grade level where the general public has direct contact with the vault or containment vehicle and not necessarily direct contact with the exterior surfaces of the equipment proper. The general construction of this equipment shall be such that authorized personnel may obtain access to the apparatus inside the equipment containment. Equipment that is below grade is intended for use at or below the high water line and can be considered to be totally submerged.

4. Enclosure design and coating system requirements

4.1 Enclosure design requirements objective

The objective of this clause is to describe the corrosion resistance requirements of carbon steel and copper bearing steel submersible enclosure systems for below grade environments. Other performance requirements may be needed to provide long field life in other environments.

4.1.1 Accessibility

The enclosure shall be designed such that all exterior surfaces are accessible for proper surface preparation and the application of a uniform amount of the coating materials. Additionally, all exterior surfaces of the

⁵345 MPa = 50 000 psi

enclosure shall be accessible for the purposes of inspection and maintenance of the enclosure over the life of the equipment.

4.1.2 Contaminant accumulation

The enclosure shall be designed to shed water and minimize areas where corrosive elements can accumulate (such as in and around cooling tubes).

4.1.3 Weld surface preparation

All welds shall be treated to prepare the weld area and the heat-affected zones for coating. Weld spatter shall be removed. All welds shall be made in accordance with appropriate industrial welding standards.

4.2 Substrate requirements

The substrate shall be a material which, when coated or otherwise processed, will maintain the structural integrity of the enclosure over the life of the apparatus.

4.3 Coating system requirements

4.3.1 General

All coated surfaces on the exterior of the enclosure that may be exposed to the environments shall be capable of meeting the performance tests required by this standard.

4.3.2 Specification of coating characteristics

If more than one coating system is used for different areas of the enclosure, the areas in which each is used shall be identified. The laboratory test performance data of each coating system shall be identified and submitted for approval upon request. This data shall be resubmitted whenever there are changes in the method and/or materials.

4.3.3 Coating touch-up prior to shipment

Touch-up, when required, shall be done at final inspection before any equipment is shipped. In areas where the integrity of the coating system is violated, the touch-up system shall blend smoothly and meet all performance criteria of the original coating system.

4.3.4 Holiday test

All coated surfaces on the exterior of each enclosure shall be certified to be free of holidays or discontinuities when tested in accordance with NACE RP 01 88-99.

4.4 Coating system test specimens

Test specimens shall consist of panels of the same material composition used in production. Test specimens shall be in accordance with Figure A.1, Figure A.2, and Figure A.3 as to size and type. Quantity and type of panels in each test are identified under the specific test. All panels shall be cleaned, coated, and cured using the production coating system. Coated test panels shall be conditioned at room temperature and humidity for a minimum of 7 days prior to any testing.

4.5 Coating system performance requirements

4.5.1 Cross hatch adhesion test

One coated panel, per Figure A.2, shall be scribed to bare metal in accordance with ASTM D3359-02. Method A shall be used for films thicker than 0.13 mm.⁶ Method B shall be used for films less than or equal to 0.13 mm.⁷ There shall be 100% adhesion to the substrate and between layers. A rating of 5A for method A and 5B for method B per ASTM D3359-02 is required.

4.5.2 Impact test

One coated panel per Figure A.2, at $-7\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ panel temperature, shall be impacted on a concrete floor per ASTM D2794-93 at a value of 9.0 Joules (9.0 newton meters) utilizing an indenter with a diameter of 12.70 mm.^{8,9,10} The impacted test panel shall be exposed to 24 hours of salt spray per ASTM B117-97. There shall be no red rust visible in the impact (intrusion) area of the panel.

4.5.3 Insulating fluid resistance test (for liquid filled units only)

Partially immerse one coated panel, per Figure A.2, in the insulating liquid for 72 hours, at $100\text{ }^{\circ}\text{C}$ – $105\text{ }^{\circ}\text{C}$.¹¹ On the immersed portion of the panel there shall be no loss of adhesion, per ASTM D3359-02, no blisters, no streaking, and no more than one pencil hardness change when tested in accordance with ASTM D3363-00. Any color change shall be noted.

4.5.4 Soak test

Partially immerse one coated panel, per Figure A.1, into Harrison's solution maintained at $65\text{ }^{\circ}\text{C}$ for 1000 hours.¹² Allow the panel to cool to room temperature and dry off. On the immersed portion of the panel there shall be no blisters and no more than one pencil hardness change when tested in accordance with ASTM D3363-00.

4.5.5 Ultraviolet accelerated weathering (QUV) and simulated corrosive atmospheric breakdown (SCAB)

Three coated panels, per Figure A.1, shall be prepared and tested in accordance with the procedure described in Annex A. The scribe shall be prepared for evaluation using ASTM D1654-92 procedure A, method 2. Upon completion of 20 cycles of SCAB, the scribe shall be divided into 6 mm zones and the worst spot in each zone shall be evaluated by measuring the amount of creepage along the scribe line (except the first 6 mm of the scribe at each end of the scribe line).^{13,14} The average of the 14 readings shall be rated per ASTM D1654-92, Table 1. After a rating has been set for each of the three panels, the average rating of the three panels shall not be less than a 6 rating. The area away from the scribe shall have no blisters.

⁶0.13 mm = 5 mils (.005 in)

⁷See footnote 5.

⁸ $-7\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C} = 20\text{ }^{\circ}\text{F} \pm 4\text{ }^{\circ}\text{F}$

⁹9.0 newton meters = 80 inch-pounds force

¹⁰12.70 mm = 0.500 in

¹¹ $100\text{ }^{\circ}\text{C}$ – $105\text{ }^{\circ}\text{C} = 212\text{ }^{\circ}\text{F}$ – $221\text{ }^{\circ}\text{F}$

¹² $65\text{ }^{\circ}\text{C} = 148\text{ }^{\circ}\text{F}$

¹³6 mm = 0.25 in

¹⁴See footnote 13.

4.5.6 Thermal cycle test

One coated panel, per Figure A.1, shall be exposed to thermal cycling for four weeks. Place test panels into a 130 °C oven for 8 hours and followed by 16 hours at 25 °C.^{15,16} This cycle is to be repeated each weekday (Monday through Friday). Maintain test panel temperature at 130 °C¹⁷ on weekends (Saturday and Sunday). Upon completion of the test, expose the panel to 24 hours of salt spray per ASTM B117-97. There shall be no blistering and no red rust visible on the panel.

4.5.7 Gravelometer test

Two panels, per Figure A.3, are to be tested per ASTM D3170-01 at room temperature using 410 kPa gauge air pressure.¹⁸ Expose the test panels for 24 hours in salt spray per ASTM B117-97. Remove from salt spray, rinse and dry panels. Evaluate panels per SAE J400-2001 for quantity and size of rusted chipped areas. Minimum rating shall be 7B per SAE J400-2001.

5. General

5.1 Shipment

The manufacturer shall provide a method of shipment that will allow the enclosure to be received by the purchaser such that it still meets the performance tests required by this standard.

5.2 Coating repair procedure

The manufacturer shall recommend a coating system repair procedure.

5.3 Installation—maintenance of coating integrity

The manufacturer shall provide a means, preferably as an inherent part of the enclosure, to minimize scratching of the coating on the base of the enclosure during handling and installation.

¹⁵130 °C = 266 °F

¹⁶25 °C = 77 °F

¹⁷See footnote 15.

¹⁸410 kPa = 60 psi

Annex A

(informative)

QUV and SCAB procedure

- a) The three panels prepared per 4.4 and evaluated per 4.5.5 are to be tested per ASTM D4587-01 QUV for 504 hours. Test equipment with FS-40 bulbs and the cycle set for four hours ultraviolet at $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ followed by four hours condensation at $50\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ is to be used.^{19,20} No evaluation is necessary after test as this is a conditioning step.
- b) Scribe the panels in accordance with ASTM D1654-92 and as shown in Figure A.1.
- c) Place the test panel (scribed side facing up) in a plastic or wood rack with the scribe line in a vertical position. The rack shall hold the panels at a 15-degree (± 5 degree) angle from the vertical. Multiple panels in the test rack should not touch one another.
- d) Expose the panels for the specified number of cycles. (One weekday equals one cycle.)
 - 1) Mondays only
 - i) One hour in oven at $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$.²¹
 - ii) 15 min in freezer at $-23\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$.²² Panel should be transferred into freezer within 1 min after removal from the oven.
 - iii) Remove the panels from the freezer and immerse in a 5% NaCl solution for 15 min. The NaCl solution should be at room temperature. The panel transfer time from freezer to the NaCl immersion should be less than 1 min.
 - iv) Remove from NaCl bath and let hang in room temperature and humidity atmosphere for 1 hour, 15 min.
 - v) Place panel in $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ ²³ and 85% $\pm 3\%$ relative humidity cabinet for 21 hours.
 - 2) Tuesday through Friday
 - i) Test panels to be immersed in 5% NaCl solution for 15 min. The NaCl solution should be at room temperature.
 - ii) Allow the test panels to age at room temperature and humidity for 1 hour, 15 min.
 - iii) Place the test panels in $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ ²⁴ and 85% $\pm 3\%$ relative humidity cabinet for 22 hours, 30 min.
 - 3) Saturdays and Sundays: Leave the test panel in the humidity cabinet at $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C}$ ²⁵ and 85% relative humidity.
 - 4) Monday (last day): Remove the test panels from the humidity cabinet and evaluate per 4.5.7.

¹⁹ $60\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C} = 140\text{ }^{\circ}\text{F} \pm 4\text{ }^{\circ}\text{F}$

²⁰ $50\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C} = 122\text{ }^{\circ}\text{F} \pm 4\text{ }^{\circ}\text{F}$


²¹See footnote 18.

²² $-23\text{ }^{\circ}\text{C} \pm 2\text{ }^{\circ}\text{C} = -10\text{ }^{\circ}\text{F} \pm 4\text{ }^{\circ}\text{F}$

²³See footnote 19.


²⁴See footnote 19.

²⁵See footnote 19.

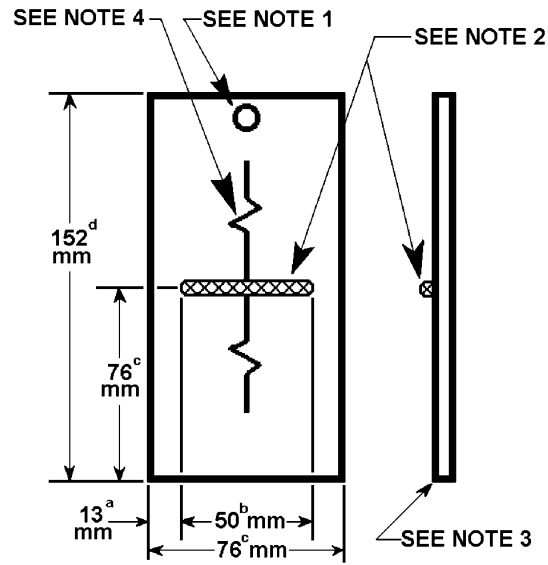


Footnotes:
a - 0.5 inch, b - 2 inches, c - 3 inches, d - 6 inches

Figure A.1—Corrosion paint test panel

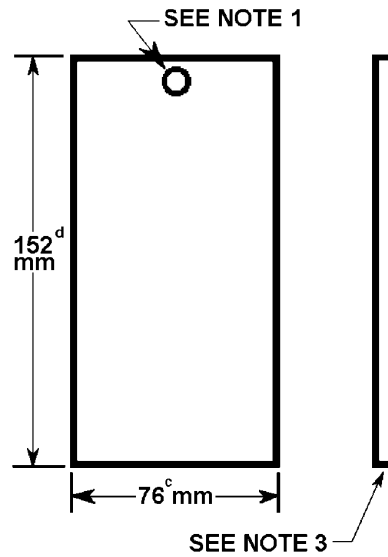

Footnotes:
c - 3 inches, d - 6 inches

Figure A.2—Plain paint test panel

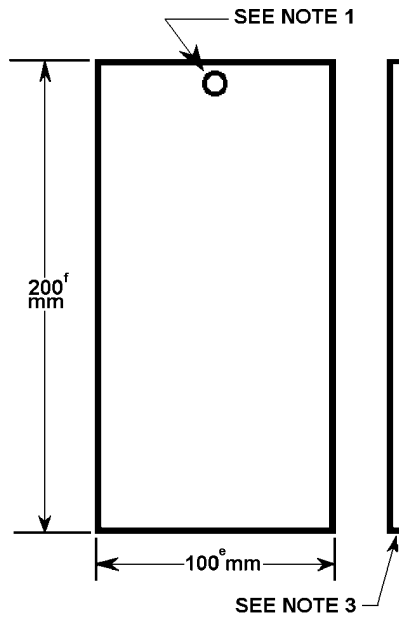

Footnotes:
e - 4 inches, f - 8 inches

Figure A.3—Gravelometer paint test panel

NOTES

- 1—Hole can be placed in panel for hanging for paint operations if required. Locate centered on short dimension and 3 mm to edge of hole on long dimension. Recommended maximum hole size 14 mm diameter.
- 2—Weld head to be the same type metal composition as the panel. Weld bead to be 6 mm wide and 3 mm high.
- 3—Test panels shall be made from typical production stock of the same material type and thickness used in the construction of the device for which the specified test is intended.
- 4—Scribe per ASTM D1654-92 across weld approximately 100 mm scribe length.

Annex B

(informative)

Bibliography

- [B1] Accredited Standards Committee C2-1997, National Electrical Safety Code® (NESC®).²⁶
- [B2] ANSI C57.12.24-1994, Underground-Type Three-Phase Distribution Transformers, 2500 kVA and Smaller; High-Voltage, 34 500 Grd Y/19 920 Volts and Below; Low-Voltage, 480 Voltage and Below-Requirements.
- [B3] ANSI C57.12.28-1999, ANSI Standard for Pad-Mounted Equipment Enclosure Integrity.
- [B4] ANSI C57.12.29-1999, ANSI Standard for Pad-Mounted Equipment Enclosure Integrity for Coastal Environments.
- [B5] ANSI C57.12.31-1996, Pole-Mounted Equipment-Enclosure Integrity.
- [B6] ANSI C57.12.40-1994, Requirements for Secondary Network Transformers, Subway and Vault Types (Liquid Immersed).
- [B7] Bringas, John E., and Wayman, Michael L., *The Metals Black Book, Ferrous Metals*, 3d ed, Edmonton, Alberta, Canada: CASTI Publishing Inc., 1998.
- [B8] IEEE 100™, *The Authoritative Dictionary of IEEE Standards Terms*, Seventh Edition, New York, Institute of Electrical and Electronics Engineers, Inc.²⁷
- [B9] IEEE Std C37.60™-1981, IEEE Standard Requirements for Overhead, Pad Mounted, Dry Vault, and Submersible Automatic Circuit Reclosers and Fault Interrupters for AC Systems.
- [B10] IEEE Std C37.63™-1997, IEEE Standard Requirements for Overhead, Pad-Mounted, Dry-Vault, and Submersible Automatic Line Sectionalizers for AC Systems.
- [B11] IEEE Std C37.71™-1990, IEEE Standard for Three-Phase, Manually Operated Subsurface Load Interrupting Switches for AC Systems.
- [B12] IEEE Std C57.12.23™-2002, IEEE Standard for Underground-Type, Self-Cooled, Single-Phase, Distribution Transformers with Separable Insulated High-Voltage Connectors; High Voltage, 25 000 V and Below; Low-Voltage, 600 V and below; 167 kVA and Smaller.
- [B13] IEEE Std C57.12.44™-1994, IEEE Standard Requirements for Secondary Network Protectors.
- [B14] IEEE Std C57.12.80™-2002, IEEE Standard Terminology for Power and Distribution Transformers.

²⁶National Electrical Safety Code and NESC are both registered trademarks and service marks of the Institute of Electrical and Electronics Engineers, Inc.

²⁷The standards or products referred to in Annex B are trademarks owned by the Institute of Electrical and Electronics Engineers, Incorporated.